


NOTE: ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF AREO-POWER UNLIMITED FUELER  
 AREO-POWER SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS, ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

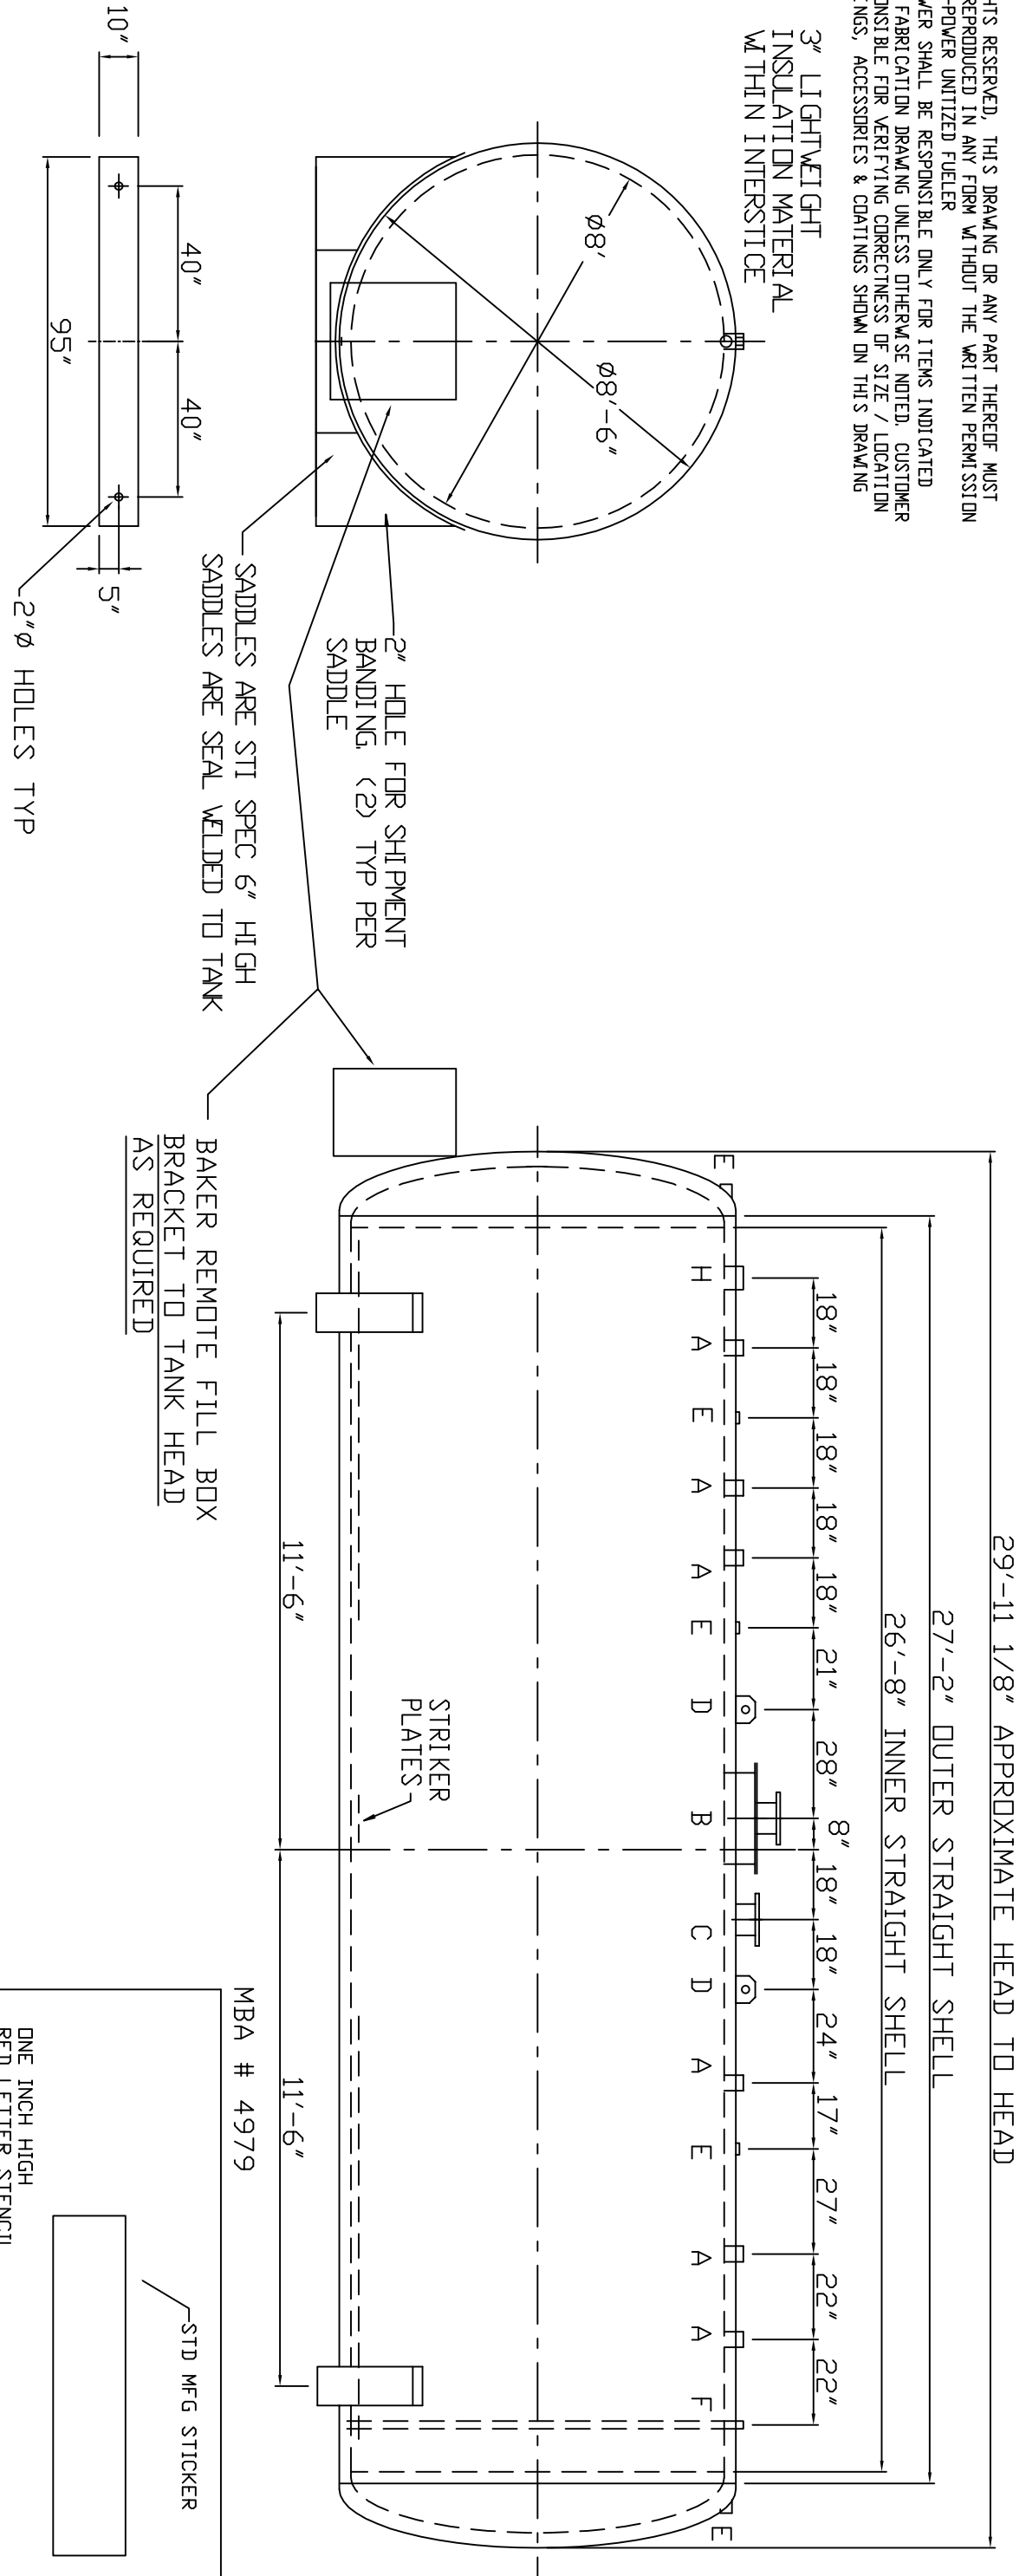

CAPACITY - 10,000 GALLONS  
 MATERIAL - MILD CARBON STEEL  
 THICKNESS - INNER SHELL - 1/4"  
 OUTER SHELL - 1/4"  
 HEADS - INNER - 5/16" MIN. STD FLGD & DISHED  
 OUTER - 5/16" MIN. STD FLGD & DISHED  
 CONSTRUCTION - INNER & OUTER - LAP WELD OUTSIDE ONLY  
 TEST - INNER - 20 PSIG HYDROTEST  
 OUTER - 5 PSIG AIR  
 PAINT - INT - NONE  
 EXT - SSPC SP6 BLAST, EPOXY PAINT SYSTEM, COLDR TO BE WHITE  
 LABEL - UL 2085, FIREGUARD, AND NEW YORK CITY

- A 4" FEMALE FG COUPLING
- B 8" X 150# RFSD FLANGE MOUNTED IN 24" X 1/2" THICK PLATE MANWAY - PRIMARY EMERGENCY VENT USE
- C 8" X 150# RFSD FLANGE THROUGH OUTER SHELL ONLY - INTERSTICE EMERGENCY VENT USE
- D LIFT LUG
- E 2" FNPT THROUGH OUTER SHELL ONLY WITH CAST IRON PLUG - FOR MFG USE ONLY
- F 2" MONITOR PIPE MALE NPT END
- G 2" FITTING THROUGH OUTER SHELL ONLY
- H 6" FEMALE FG COUPLING

MBA # 4979

ONE INCH HIGH RED LETTER STENCIL OR VINYL LABEL FDNVC C of A 4979

STD MFG STICKER

STD AREO STICKER

THIS TO BE ADDED TO BOTH SIDES OF TANK

**AREO-POWER**®

10,000 GAL 96"Ø FIREGUARD®  
 NEW YORK CITY STYLE

CUSTOMER: ---  
 PROJECT: ---  
 QUOTE NO: ---

SCALE 1/4" = 1' - 0"	DATE 9/2/04	DRAWN BY 006	CHK'D BY	DWG NO 43205C
-------------------------	----------------	-----------------	----------	------------------