

DRAWING TITLE

NEW YORK CITY
2500 GAL U/G
TYPE 1 DW


NOTE :
ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.
HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

FITTING SCHEDULE

- A= 5" ϕ NPT WITH 5" x 4" NYLON BUSHING
- B= 3" ϕ NPT WITH 3" x 2" NYLON BUSHING
(FITTING FOR LEAK DETECTION W/ INTERNAL PIPE)

GENERAL NOTES

- CAPACITY : 2500 GALLONS
- TYPE : 1 360 DOUBLE WALL, UNDERGROUND, NY CITY
- NO. REQ. :
- MATERIAL : MILD CARBON STEEL
- TEST : 50 P.S.I. INNER 6 P.S.I. OUTER
- MIN. GAUGE OR THICKNESS (PER U.L. 58) :
- (BASED ON 60" MAX. DURAL DEPTH)
- INNER HEADS : 8/18" OUTER HEADS : 10 GA.
- INNER SHELL : 1/4" OUTER SHELL : 10 GA.
- PAINT :
- INTERIOR : NONE
- EXTERIOR : SP-8 BLAST COAT WITH :
 - CORRODOTE PLUS 13 MILS
 - POLYURETHANE 70 MILS
 - FIBERGLASS 125 MILS
 - REINFORCED POLYESTER
- CONSTRUCTION : FLANGED & DISHED HEADS, LAP WELD
- ALL EXTERIOR SEAMS ONLY
- APPROVED LABELS : U.L. 68, NYC, NYDRR PART 814
 - S.T.J.P.3
 - ACT-100-U
 - ACT-100
- 13000 VOLT SPARK TEST PROVIDED AT FACTORY FOR POLYURETHANE MODELS
- 35000 VOLT SPARK TEST PROVIDED AT FACTORY FOR F.R.P. MODELS

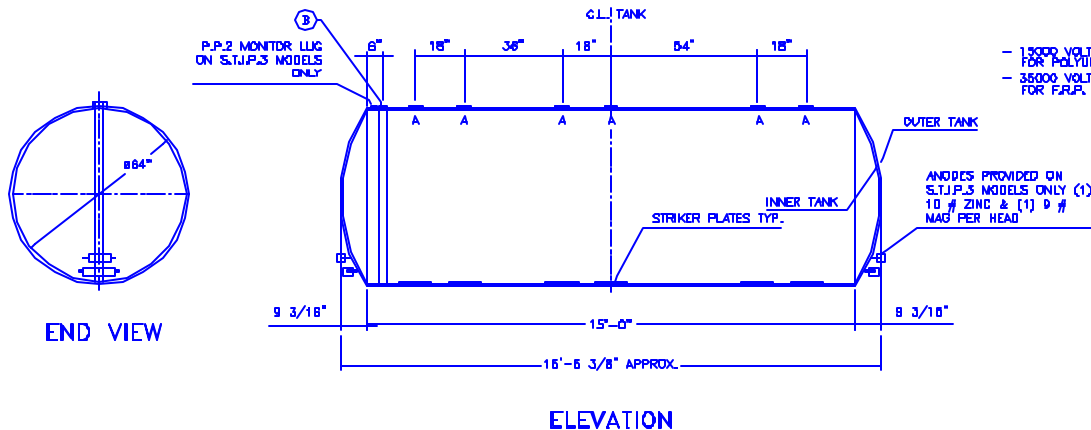

REV	DATE	BY	REVISION DESCRIPTION

ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION OF AREO-POWER UNITIZED FUELER, INC.

DWC NO: 2.5K DWINYCLG	
SCALE: 1/4"=1'	DWN BY: HT
SHEET: 1	DATE: 11/1/02