

DRAWING TITLE

**NEW YORK CITY**  
**300 GAL U/G**  
**TYPE 1 DW**

NOTE :  
ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.  
HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

**FITTING SCHEDULE**

- A- 3" ⌀ NPT WITH 3" x 2" NYLON BUSHING
- B- 3" ⌀ NPT WITH 3" x 2" NYLON BUSHING  
(FITTING FOR LEAK DETECTION W/ INTERNAL PIPE)
- C- 5" ⌀ NPT WITH 5" x 4" NYLON BUSHING

**GENERAL NOTES**


CAPACITY : 300 GALLONS  
TYPE : 1 3RD DOUBLE WALL, UNDERGROUND, NY CITY  
NO. REQ. :  
MATERIAL : MILD CARBON STEEL  
TEST : 30 P.S.I. INNER 5 P.S.I. OUTER  
MIN. GAUGE OR THICKNESS (PER U.L. 58 ) :  
(BASED ON 60" MAX. BURIAL DEPTH)  
INNER HEADS : 5/16" OUTER HEADS : 10 GA.  
INNER SHELL : 1/4" OUTER SHELL : 10 GA.  
PAINT :

- INTERIOR : NONE
- EXTERIOR : SP-5 BLAST COAT WITH :
  - CORRODOTE PLUS 15 MILS
  - POLYURETHANE 70 MILS
  - FIBERGLASS REINFORCED POLYESTER 125 MILS

CONSTRUCTION : FLANGED & DISHED HEADS, LAP WELD  
ALL EXTERIOR SEAMS ONLY  
APPROVED LABELS : U.L. 58, NYC, NYORR PART 914

- S.T.I.P.3
- ACT-100-U
- ACT-100

- 15000 VOLT SPARK TEST PROVIDED AT FACTORY FOR POLYURETHANE MODELS
- 35000 VOLT SPARK TEST PROVIDED AT FACTORY FOR F.R.P. MODELS

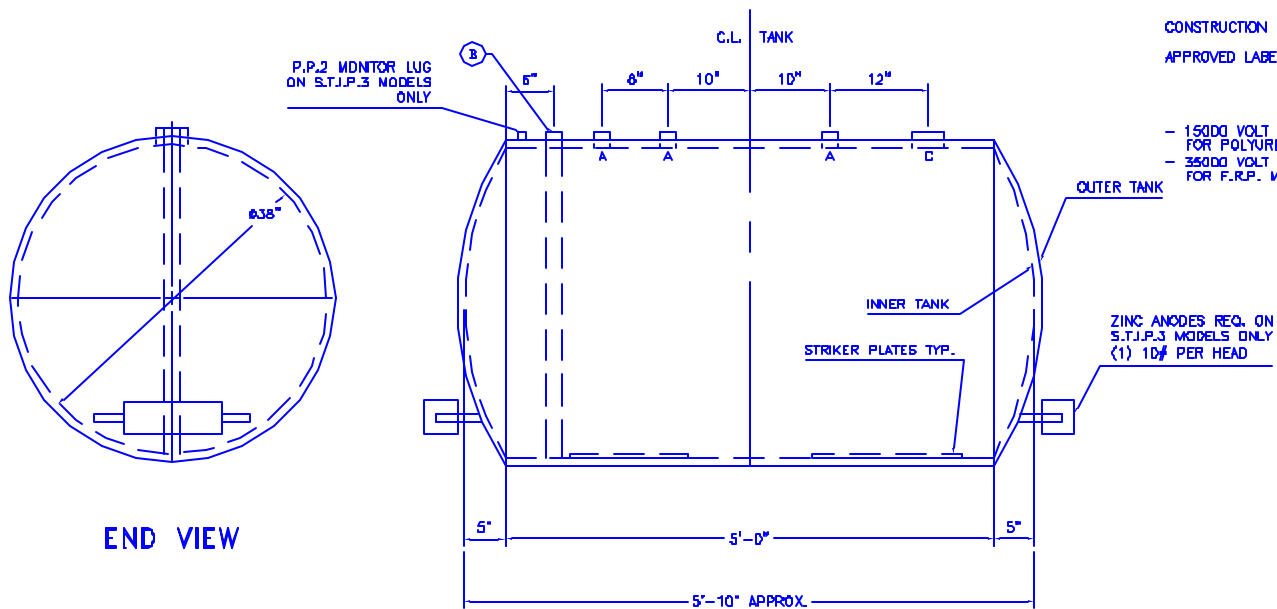

END VIEW

ELEVATION

REVISION DESCRIPTION  
BY  
DATE  
REV

ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION OF AREO-POWER UNITIZED FUELER, INC.

DWC NO: 300 DWINYCLIG	
SCALE: 3/4"=1"	DWN BY: HT
SHEET: 1	DATE: 11/1/02