

DRAWING TITLE

NEW YORK CITY  
8000 GAL (120" Ø) U/G  
TYPE 1 DW

NOTE:  
ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF HIGHLAND TANK.  
HIGHLAND TANK SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED ON THIS FABRICATION DRAWING UNLESS OTHERWISE NOTED. CUSTOMER IS RESPONSIBLE FOR VERIFYING CORRECTNESS OF SIZE / LOCATION OF FITTINGS, ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

**FITTING SCHEDULE**

A= 5" Ø NPT WITH 5" x 4" NYLON BUSHING  
B= 3" Ø NPT WITH 3" x 2" NYLON BUSHING  
(FITTING FOR LEAK DETECTION W/ INTERNAL PIPE)

**GENERAL NOTES**

CAPACITY : 8000 GALLONS  
TYPE : 1 360 DOUBLE WALL, UNDERGROUND, NY CITY  
NO. FEED : 1  
MATERIAL : MILD CARBON STEEL  
TEST : 30 P.S.I. INNER 3 P.S.I. OUTER  
MIN. GAUGE OR THICKNESS (PER U.L. 581) :  
(BASED ON 60" MAX. BURIAL DEPTH)  
INNER HEADS : 3/8" OUTER HEADS : 1/4"  
INNER SHELL : 5/16" OUTER SHELL : 7 GA.  
PAINT :


- INTERIOR : NONE  
EXTERIOR : SP-8 BLAST, COAT WITH :  
 CORROGATE PLUS 15 MILS  
 POLYURETHANE 70 MILS  
 FIBERGLASS REINFORCED POLYESTER 125 MILS

CONSTRUCTION : FLANGED & DISHED HEADS, LAP WELD  
ALL EXTERIOR SEAMS ONLY

APPROVED LABELS : U.L. 581, NYC, NYCRR PART 614

- S.J.L.P.3  
 ACT-100-U  
 ACT-100

- 15000 VOLT SPARK TEST PROVIDED AT FACTORY FOR POLYURETHANE MODELS
- 35000 VOLT SPARK TEST PROVIDED AT FACTORY FOR F.R.P. MODELS

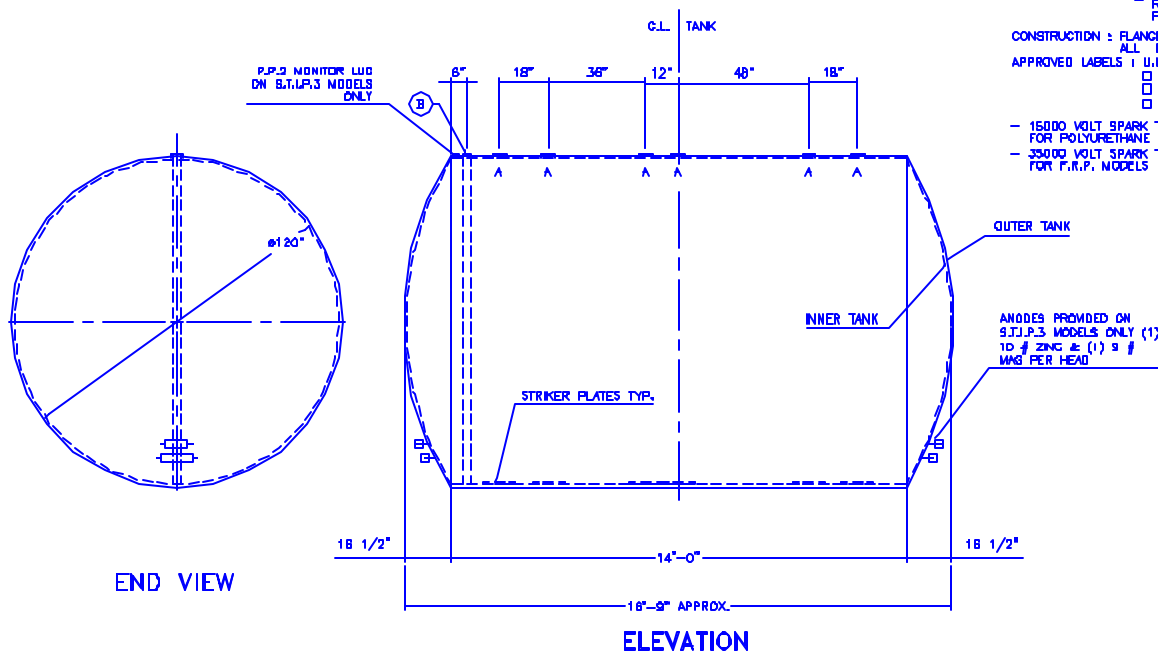

REV	DATE	BY	REVISION DESCRIPTION

ALL RIGHTS RESERVED. THIS DRAWING OR ANY PART THEREOF MUST NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION OF AREO-POWER UNITIZED FUELER, INC.

DWC NOBK DWNYCLIG12D	
SCALE: 3/8"=1"	DWN BY: HT
SHEET: 1	DATE: 11/1/02